

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

EXHIBIT B2 TRUSS SPECIFICATIONS

1.0 GENERAL

1.1 Scope

These specifications are for a fully engineered clear span bridge(s) of steel construction and shall be regarded as minimum standards for design and construction. These specifications are based on products designed and manufactured by CONTECH Engineered Solutions, LLC.

1.2 Qualified Suppliers

Each bidder is required to identify their intended bridge supplier as part of the bid submittal. Qualified suppliers must have at least 10 years of experience fabricating these type structures.

Pre-approved Manufacturers:

CONTECH Engineered Solutions, LLC

8301 State Highway 29 North
Alexandria, Minnesota 56308
1-800-328-2047

4021 Gault Avenue South
Fort Payne, Alabama 35967
1-800-749-7515

Suppliers other than those listed above may be used provided the engineer or owner's agent evaluates the proposed supplier and approves the supplier 5 days prior to bid.

The contractor must provide the following documentation, for any proposed supplier who is not pre-approved, at least 10 days prior to bid:

1. Product Literature
2. All documentation to insure the proposed substitution will be in compliance with these specifications. This shall include:
 - Representative design calculations
 - Representative drawings
 - Splicing and erection procedures
 - Warranty information
 - Inspection and Maintenance procedures
 - AISC Shop Certification
 - AWS Certified Fabricator Certification
 - Welder Qualifications
 - Evidence of 2 Certified Weld Inspectors (CWI's) on staff
3. Proposed suppliers must have at least ten (10) years of experience designing and fabricating these type of structures and a minimum of ten (10) successful bridge projects, of similar construction, each of which has been in service at least seven (7) years. List the location, bridge size, owner, and a contact for reference for each project.

The engineer will evaluate and verify the accuracy of the submittal prior to bid. If the engineer determines that the qualifying criteria have not been met, the contractor's proposed supplier shall be rejected. The engineer's ruling shall be final.

4. The Manufacturer's representative is to be in attendance at the project pre-bid and/or

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

pre-construction meeting.

2.0 GENERAL FEATURES OF DESIGN

- 2.1 Span: Bridge span shall be 142'-0" (straight line dimension) and shall be as measured from each end of the bridge structure. A support shall be located at 64'-0" from the low end of the structure. The bridge is to be erected on existing piers and abutments. Contractor shall field verify placement of the existing pier and abutments prior to fabrication of the bridge.
- 2.2 Width: Bridge width shall be 6'-0" and shall be as measured from the inside face of structural elements at deck level.
- 2.3 Bridge System Type: Bridge(s) shall be designed as a Connector® (Half-Thru Pratt truss) (or equal), that has one (1) diagonal per panel and plumb end vertical members. Interior vertical members may be either plumb or perpendicular to the chord faces.
- 2.3.1 Bridge(s) shall be designed utilizing an underhung floor beam (top of floor beam welded to the bottom of the bottom chord) or be designed utilizing an H-Section configuration where the floor beams are placed up inside the trusses and attached to the truss verticals.
- 2.3.2 The bridge manufacturer shall determine the distance from the top of the deck to the top and bottom truss members based upon structural and/or shipping requirements.
- 2.3.3 The top of the top chord shall not be less than 54 inches above the deck (measured from the high point of the riding surface) on bike path structures.

2.4 Member Components

All members of the vertical trusses (top and bottom chords, verticals, and diagonals) shall be fabricated from square and/or rectangular structural steel tubing. Other structural members and bracing shall be fabricated from structural steel shapes or square and rectangular structural steel tubing.

Unless the floor and fastenings are specifically designed to provide adequate lateral support to the top flange of open shape stringers (w-shapes or channels), a minimum of one stiffener shall be provided in each stringer at every floor beam location.

2.5 Attachments

- 2.5.1 Safety Rails: Horizontal safety rails shall be placed on the structure up to a minimum height of 4'-6" above the deck surface. Safety rails shall be placed so as to prevent a 4" sphere from passing through the truss. Safety rails shall be placed on the inside or outside of the structure at the bridge fabricator's option. Safety rails placed on the inside of the truss shall have their ends sealed and ground smooth so as to produce no sharp edges.

The safety rail system shall be designed for an infill loading of 200 pounds, applied horizontally at right angles, to a one square foot area at any point in the system.

- 2.5.3 Toe Plate: The bridge shall be supplied with a steel toe plate mounted to the inside face of both trusses. The toe plate shall be a minimum of 4 inches high. Toe plating will be

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

welded to the truss members at a height adequate to provide a 2" gap between the bottom of the plate and the top of the deck or the top of the bottom chord, whichever is higher. The span of unstiffened flat toe plating (from center to center of supports) shall not exceed 5'-8".

- 2.6 Camber: The bridge shall have a vertical camber dimension at midspan equal to 100% of the full dead load deflection plus 1% of the full length of the bridge.
- 2.7 Elevation Difference: The bridge abutments shall be constructed with different elevations on both ends of the bridge. The bridge abutments and midspan pier are existing concrete. The bridge shall be constructed to bear on the existing pier and abutments, and to match the existing elevations at midspan and each end abutment of the bridge.

3.0. ENGINEERING

Structural design of the bridge structure(s) shall be performed by or under the direct supervision of a licensed professional engineer and done in accordance with recognized engineering practices and principles. The Licensed Professional Engineer is to hold a current P.E. or S.E. license (where required) in the State of Connecticut where the bridge will be erected.

- 3.1 Design Loads: In considering design and fabrication issues, this structure shall be assumed to be statically loaded. No dynamic analysis shall be required nor shall fabrication issues typically considered for dynamically loaded structures be considered for this bridge. The Fracture Critical requirements have been waived, including article 8.2.3 of the AASHTO LRFD Guide Specification for Design of Pedestrian Bridges, December 2009.

3.1.1 Dead Load: The bridge structure design shall consider its own dead load (superstructure and original decking), as well as the additional loads listed below.

3.1.2 Uniform Live Load

3.1.2.1 Pedestrian Live Load

Main Members: Main supporting members shall be designed for a pedestrian live load of 90 pounds per square foot of bridge walkway area. The pedestrian live load shall be applied to those areas of the walkway so as to produce maximum factored load in the member being designed.

3.1.3 Concentrated Loads: The bridge superstructure, floor system and decking shall be designed for each of the following point load conditions:

A four wheeled vehicle with the appropriate wheelbase, tire track and tire print area shall be applied. The vehicle load applied is dependent on the bridge width. Bridge widths 7 feet and lower shall be designed for a 4,000 pound vehicle with a 50% wheel distribution, widths between 7 and including 10 feet shall be designed for an H-5 vehicle load, and widths greater than 10 feet shall be designed for an H-10 vehicle load. Both H-5 and H-10 loads shall be considered with an 80% rear wheel distribution.

A vehicle impact allowance is not required.

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

3.1.4 Wind Load

3.1.4.1 Horizontal Forces

The bridge(s) shall be designed for a minimum wind load of 35 pounds per square foot on the full vertical projected area of the bridge as if enclosed. Wind load shall be considered in accordance with AASHTO Signs and Luminaires, but in no case will the wind load be taken as less than 35 pounds per square foot. The wind load shall be applied horizontally at right angles to the longitudinal axis of the structure.

The wind loading shall be considered both in the design of the lateral load bracing system and in the design of the truss vertical members, floor beams and their connections.

3.1.4.2 Overturning Forces

The effect of forces tending to overturn structures shall be calculated assuming that the wind direction is at right angles to the longitudinal axis of the structure. In addition, an upward force shall be applied at the windward quarter point of the transverse superstructure width. This force shall be 20 pounds per square foot of deck.

3.1.5 Top Chord/Railing Loads

The top chord, truss verticals, and floor beams shall be designed for lateral wind loads (per section 3.1.4.1) and for any loads required to provide top chord stability as outlined in Section 3.3.6; however, in no case shall the load be less than 50 pounds per lineal foot or a 200 pound point load, whichever produces greater stresses, applied in any direction at any point along the top chord or at the top of the safety system (42" or 54" above deck level), if higher than the top chord.

3.1.6 Load Combinations: The load combinations shall follow AASHTO LRFD "Standard Specifications for Highway Bridges" latest edition.

It shall be the responsibility of the foundation engineer to determine any additional loads (i.e. earth pressure, stream force on abutments, wind loads other than those applied perpendicular to the long axis of the bridge, etc.) and load combinations required for design of the abutments.

3.2 Design Limitations

3.2.1 Deflection

3.2.1.1 Vertical Deflection

The vertical deflection of the main trusses due to service pedestrian live load shall not exceed 1/360 of the span.

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

The deflection of the floor system members (floor beams and stringers) due to service pedestrian live load shall not exceed 1/360 of their respective spans.

Deflection limits due to occasional vehicular traffic shall not be considered.

3.2.1.2 Horizontal Deflection

The horizontal deflection of the structure due to lateral wind loads shall not exceed 1/360 of the span under design wind load.

3.2.2 Vibration

Vibration of the structure shall not cause discomfort or concern to users. Except as specified herein, the fundamental frequency in a vertical mode without live load shall be greater than 3.0 hertz. In the lateral direction, the fundamental frequency of the bridge shall be greater than 1.3 hertz. If the bridge cannot satisfy these limitations in the vertical direction, the bridge may be proportioned to satisfy the following criteria:

$$f \geq 2.86 \ln \left(\frac{180}{W} \right)$$

Where:

f = the fundamental frequency in the vertical direction (Hz)

W = the weight of the supported structure, including only dead load (kips)

From bridge design and fabrication experience, bridges with spans between 90 and 110 feet with concrete decks have exhibited vibration problems. To address this issue, the previous equation is limited and a fundamental frequency of at least 2.6 hertz must be met in the vertical direction when the bridge has a span in the 90 to 110 feet range and a concrete deck.

3.2.3 Minimum Thickness of Metal

The minimum thickness of all structural steel members shall be 1/4" nominal and be in accordance with the AISC Manual of Steel Construction's "Standard Mill Practice Guidelines". For ASTM A500 and ASTM A847 tubing, the section properties used for design shall be per the Steel Tube Institute of North America's Hollow Structural Sections "Dimensions and Section Properties".

3.3 Governing Design Codes / References

Structural members shall be designed in accordance with recognized engineering practices and principles as follows:

3.3.1 Structural Steel

American Association of State Highway and Transportation Officials (AASHTO). Shall be in accordance with "LRFD Guide Specification for the Design of Pedestrian Bridges" latest edition (AASHTO).

3.3.2 Welded Tubular Connections

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

American Association of State Highway and Transportation Officials / American Welding Society (AASHTO/AWS) and the American Institute of Steel Construction (AISC).

All welded tubular connections shall be checked, when within applicable limits, for the limiting failure modes outlined in AASHTO or in accordance with the "Manual of Steel Construction: LRFD; (Load Resistance Factor Design)" as published by the American Institute of Steel Construction (AISC).

3.3.3 Concrete

American Association of State Highway and Transportation Officials (AASHTO).

Shall be in accordance with AASHTO, "LRFD Bridge Design Specifications", latest edition.

3.3.4 Top Chord Stability

Structural Stability Research Council (SSRC), formerly Column Research Council.

The top chord shall be considered as a column with elastic lateral supports at the panel points. The critical buckling force of the column, so determined, shall exceed the maximum force from dead load and live load (uniform or vehicular) in any panel of the top chord by not less than 50 percent for parallel chord truss bridges or 100 percent for bowstring bridges. The design approach to prevent top chord buckling shall be as outlined by E.C. Holt's research work in conjunction with the Column Research Council on the stability of the top chord of a half-through truss.

For uniformly loaded bridges, the vertical truss members, the floor beams and their connections (transverse frames) shall be proportioned to resist a lateral force of not less than $1/100k$ times the top chord compressive load, but not less than .004 times that top chord load, applied at the top chord panel points of each truss. The top chord load is determined by using the larger top chord axial force in the members on either side of the "U-frame" being analyzed. For end frames, the same concept applies except the transverse force is 1% of the axial load in the end post member.

For bridges with vehicle loads, the lateral force applied at the top chord elevation for design of the transverse frames shall not be less than 1% of the top chord compression due to dead load plus any vehicle loading.

The bending forces in the transverse frames, as determined above, act in conjunction with all forces produced by the actual bridge loads as determined by an appropriate analysis which assumes that the floor beams are "fixed" to the trusses at each end.

NOTE: The effects of three dimensional loading (including "U-frame" requirements) shall be considered in the design of the structure. The "U-frame" forces shall be added to the forces derived from a three dimensional analysis of the bridge.

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

4.0 MATERIALS

4.1 Steel

4.1.1 Unpainted Weathering Steel

Bridges which are not to be painted shall be fabricated from high strength, low alloy, atmospheric corrosion resistant ASTM A847 cold-formed welded square and rectangular tubing and/or ASTM A588, or ASTM A242, ASTM A606 plate and structural steel shapes ($F_y = 50,000$ psi). The minimum corrosion index of atmospheric corrosion resistant steel, as determined in accordance with ASTM G101, shall be 6.0.

4.3 Decking

4.3.1 Treated Wood Decking

4.3.1.1 Wood decking shall be Southern Yellow Pine planks (Minimum $F_b=1,300$ psi) or Select Structural Fir planks (Minimum $F_b=1,400$ psi). Decking to be treated to AWWA standards. Preservative utilized shall be Alkaline Copper Quaternary (ACQ). Decking shall be treated to a total absorption of 0.40 pounds per cubic foot of wood or to refusal.

4.3.1.2 Wood Decking Attachment

- * At time of installation, planks are to be placed tight together with no gaps.
- * Every plank must be attached with at least one fastener at each end.
- * All fasteners to be zinc plated. Self-tapping screws or hex-head bolts, with a steel plank holddown, are to be used at the ends of planks. Self-tapping screws or carriage bolts are to be used as interior connection fasteners when required. Power actuated fasteners will not be allowed.
- * Planks are to be drilled prior to installation of bolts and/or screws.
- * In addition to at least one fastener at each end of every plank (typical for all installations), planks for bridges with widths of 72" to 143" shall be attached with a minimum of two fasteners at a location approximately near the center of the bridge width. Bridges wider than 143" are to have two fasteners located at a minimum of two interior stringer locations, approximately at the third points of the bridge width.

NOTE: Attachments at the ends of the planks may be modified as required when obstructions, such as interior safety system elements, prevent installation of the specified holddown system.

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

5.0 WELDING

- 5.1 Welding: Welding and weld procedure qualification tests shall conform to the provisions of ANSI/AWS D1.1 "Structural Welding Code", 1996 Edition. Filler metal shall be in accordance with the applicable AWS Filler Metal Specification (i.e. AWS A 5.28 for the GMAW Process). For exposed, bare, unpainted applications of corrosion resistant steels (i.e. ASTM A588 and A847), the filler metal shall be in accordance with AWS D1.1, Section 3.7.3.
- 5.2 Welders: Welders shall be properly accredited operators, each of whom shall submit certification of satisfactorily passing AWS standard qualification tests for all positions with unlimited thickness of base metal, have a minimum of 6 months experience in welding tubular structures and have demonstrated the ability to make uniform sound welds of the type required.

6.0 SUBMITTALS

- 6.1 Submittal Drawings: Schematic drawings and diagrams shall be submitted to the customer for their review after receipt of order. Submittal drawings shall be unique drawings, prepared to illustrate the specific portion of the work to be done. All relative design information such as member sizes, bridge reactions, and general notes shall be clearly specified on the drawings. Drawings shall have cross referenced details and sheet numbers. All drawings shall be signed and sealed by a Professional Engineer who is licensed in accordance with Section 3.0.
- 6.2 Structural Calculations: Structural calculations for the bridge superstructure shall be submitted by the bridge manufacturer and reviewed by the approving engineer. All calculations shall be signed and sealed by a Professional Engineer who is licensed in accordance with Section 3.0. The calculations shall include all design information necessary to determine the structural adequacy of the bridge. The calculations shall include the following:
- * All AASHTO allowable stress checks for axial, bending and shear forces in the critical member of each truss member type (i.e. top chord, bottom chord, floor beam, vertical, etc.).
 - * Checks for the critical connection failure modes for each truss member type (i.e. vertical, diagonal, floor beam, etc.). Special attention shall be given to all welded tube on tube connections (see section 3.3.2 for design check requirements).
 - * All bolted splice connections.
 - * Main truss deflection checks.
 - * U-Frame stiffness checks (used to determine K factors for out-of-plane buckling of the top chord) for all half through or "pony" truss bridges.
 - * Deck design.
- NOTE: The analysis and design of triangulated truss bridges shall account for moments induced in members due to joint fixity where applicable. Moments due to both truss deflection and joint eccentricity must be considered.
- 6.3 Welder certifications in compliance with AWS standard qualification tests.

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

6.4 Welding procedures in compliance with Section 5.1.

7.0 FABRICATION


7.1 General Requirements

7.1.1 Drain Holes

When the collection of water inside a structural tube is a possibility, either during construction or during service, the tube shall be provided with a drain hole at its lowest point to let water out.

7.1.2 Welds

Special attention shall be given to developing sufficient weld throats on tubular members. Fillet weld details shall be in accordance with AWS D1.1, Section 3.9 (See AWS Figure 3.2). Unless determined otherwise by testing, the loss factor "Z" for heel welds shall be in accordance with AWS Table 2.8. Fillet welds which run onto the radius of a tube shall be built up to obtain the full throat thickness (See Figure 7.1). The maximum root openings of fillet welds shall not exceed 3/16" in conformance with AWS D1.1, Section 5.22. Weld size or effective throat dimensions shall be increased in accordance with this same section when applicable (i.e. fit-up gaps > 1/16").

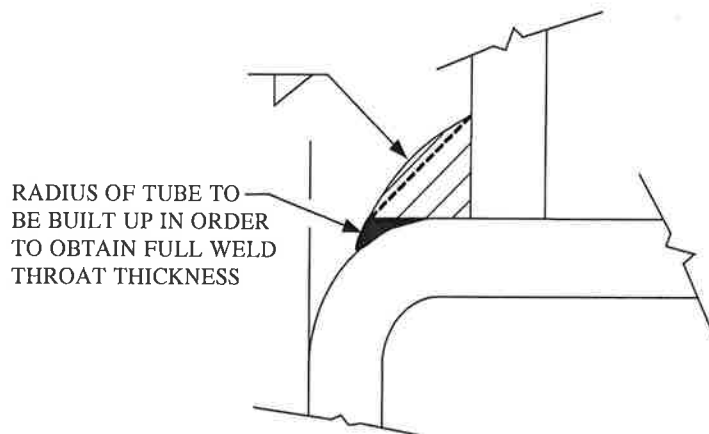

**FIGURE 7.1
BUILD UP RADIUS WELD**

The fabricator shall have verified that the throat thickness of partial joint penetration groove welds (primarily matched edge groove welds or the flare-bevel-groove welds on underhung floor beams) shall be obtainable with their fit-up and weld procedures. Matched edge groove welds shall be "flushed" out when required to obtain the full throat or branch member wall thickness.

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

For full penetration butt welds of tubular members, the backing material shall be fabricated prior to installation in the tube so as to be continuous around the full tube perimeter, including corners. Backing may be of four types:

- * A "box" welded up from four (4) plates.
- * Two "channel" sections, bent to fit the inside radius of the tube, welded together with full penetration welds.
- * A smaller tube section which slides inside the spliced tube.
- * A solid plate cut to fit the inside radius of the tube.

Corners of the "box" backing, made from four plates, shall be welded and ground to match the inside corner radii of the chords. The solid plate option shall require a weep hole either in the chord wall above the "high side" of the plate or in the plate itself. In all types of backing, the minimum fit-up tolerances for backing must be maintained at the corners of the tubes as well as across the "flats".

7.2 Quality Certification

Bridge(s) shall be fabricated by a fabricator who is currently certified by the American Institute of Steel Construction to have the personnel, organization, experience, capability, and commitment to produce fabricated structural steel for the category "Major Steel Bridges" as set forth in the AISC Certification Program with Fracture Critical Endorsement. Quality control shall be in accordance with procedures outlined for AISC certification. For painted structures, the fabricator must hold a "Sophisticated Paint Endorsement" as set forth in the AISC certification program. Furthermore, the bridge(s) shall be fabricated in a facility owned and/or leased by the corporate owner of the manufacturer, and fully dedicated to bridge manufacturing.

8.0 FINISHING

8.1 Blast Cleaning

8.1.1 Bare applications of enhanced corrosion resistant steels.

All Blast Cleaning shall be done in a dedicated OSHA approved indoor facility owned and operated by the bridge fabricator. Blast operations shall use Best Management Practices and exercise environmentally friendly blast media recovery systems.

To aid in providing a uniformly "weathered" appearance, all exposed surfaces of steel shall be blast cleaned in accordance with Steel Structures Painting Council Surface Preparation Specifications No. 7 Brush-Off Blast Cleaning, SSPC-SP7 latest edition.

Exposed surfaces of steel shall be defined as those surfaces seen from the deck and from outside of the structure. Stringers, floor beams, lower brace diagonals and the inside face of the truss below deck and bottom face of the bottom chord shall not be blasted.

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

9.0 DELIVERY AND ERECTION

Delivery is made to a location nearest the site which is easily accessible to normal over-the-road tractor/trailer equipment. All trucks delivering bridge materials will need to be unloaded at the time of arrival.

The manufacturer will provide detailed, written instruction in the proper lifting procedures and splicing procedures (if required). The method and sequence of erection shall be the responsibility of others.

The bridge manufacturer shall provide written inspection and maintenance procedures to be followed by the bridge owner.

10.0 BEARINGS

10.1 Bearing Devices

Bridge bearings shall consist of a steel setting or slide plate placed on the abutment or grout pad. The bridge bearing plate which is welded to the bridge structure shall bear on this setting plate. One end of the bridge will be fixed by fully tightening the nuts on the anchor bolts at that end. The opposite end will have finger tight only nuts to allow movement under thermal expansion or contraction.

The bridge bearings shall sit in a recessed pocket on the concrete abutment. Minimum 28-day strength for the abutment concrete shall be 3,000 PSI. The bearing seat shall be a minimum of 16" wide. The step height (from bottom of bearing to top-of-deck) shall be determined by the bridge manufacturer.

Bridges in excess of 100 feet in length or bridges with dead load reactions of 15,000 pounds or more (at each bearing location) shall have teflon on teflon or stainless steel on teflon slide bearings placed between the bridge bearing plate and the setting plate. The top slide plate shall be large enough to cover the lower teflon slide surface at both temperature extremes.

11.0 FOUNDATIONS

Unless specified otherwise, the bridge manufacturer shall determine the number, diameter, minimum grade and finish of all anchor bolts. The anchor bolts shall be designed to resist all horizontal and uplift forces to be transferred by the superstructure to the supporting foundations. Engineering design of the bridge supporting foundations (abutment, pier, bracket and/or footings), including design of anchor bolt embedments, shall be the responsibility of the foundation engineer. The contractor shall provide all materials for (including anchor bolts) and construction of the bridge supporting foundations. The contractor shall install the anchor bolts in accordance with the manufacturer's anchor bolt spacing dimensions.

Information as to bridge support reactions and anchor bolt locations will be furnished by the bridge manufacturer after receipt of order and after the bridge design is complete.

12.0 PAYMENT

A partial payment or "deposit" for the prefabricated bridge shall be made upon order and storage

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

as required by the terms of the manufacturer.

13.0 WARRANTY

The bridge manufacturer shall warrant that it can convey good title to the goods, that they are free of liens and encumbrances and that their steel structure(s) are free of design, material and workmanship defects for a period of ten years from the date of delivery. Durable hardwood decking and hardwood attachments shall carry a ten-year warranty against rot, termite damage or fungal decay. Other types of wood and decking material such as Southern Yellow Pine, Douglas Fir and composites carry no warranty. There are no warranties, expressed or implied with respect to structures sold hereunder which are used, supplied for use or made available for use in any nuclear application of which bridge manufacturer has not been notified in writing at the time of order of the structure(s).

This warranty shall not cover defects in the bridge caused by abuse, misuse, overloading, accident, improper installation, maintenance, alteration or any other cause not expressly warranted. This warranty does not cover damage resulting from or relating to the use of any kind of de-icing material. This warranty shall be void unless owner's records are supplied which show compliance with the minimum guidelines specified in the "Recommendations for the Inspection and Maintenance of Steadfast Vehicular Steel Bridges and Continental Pedestrian Steel Bridges," attached hereto and incorporated herein by this reference.

Repair, replacement or adjustment, at the sole discretion of the bridge manufacturer, shall be the exclusive remedy for defects under this warranty. Under no circumstances shall the bridge manufacturer be liable for any consequential or incidental damages.

Any claim under this warranty shall be made promptly and directly to CONTECH Bridge Solutions Inc who shall have the option, at its sole discretion, to repair, replace or adjust any covered defect without charge to the original purchaser.

SELLER MAKES NO OTHER WARRANTY WHATSOEVER, EXPRESS OR IMPLIED. ALL IMPLIED WARRANTIES OF MERCHANTABILITY AND ALL IMPLIED WARRANTIES OF FITNESS FOR ANY PARTICULAR PURPOSE ARE DISCLAIMED BY SELLER AND EXCLUDED FROM THIS CONTRACT.

REV: 10/07

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

14.0 APPROVAL CHECKLIST

The following checklist will be used in the evaluation of all submittals to assure compliance with the Special Specifications for Prefabricated Bridge. This checklist is considered the minimum acceptable requirements for compliance with these specifications. Any deviations from this checklist shall be considered grounds for rejection of the submittal. Any costs associated with delays caused by the rejection of the submittal, due to non-compliance with this checklist, shall be fully borne by the contractor and bridge supplier.

SUBMITTAL DRAWINGS

Data Required to be Shown:

- | | |
|--|--|
| <ul style="list-style-type: none"> <input type="checkbox"/> Bridge Elevation Face Checks <input type="checkbox"/> Bridge Cross Section <input type="checkbox"/> All Member Sizes <input type="checkbox"/> All Vertical Truss Members are Square or Rectangular Tubing <input type="checkbox"/> Bridge Reactions <input type="checkbox"/> General Notes Indicating <ul style="list-style-type: none"> <input type="checkbox"/> AISC Stress Conformance <input type="checkbox"/> Material Specifications to be Followed <input type="checkbox"/> Design Live Load <input type="checkbox"/> Design Vehicle Load (If Applicable) Frame" <input type="checkbox"/> Design Wind Load <input type="checkbox"/> Other Specified Design Loads <input type="checkbox"/> Welding Process Eccentricity <input type="checkbox"/> Blast Cleaning <input type="checkbox"/> Paint System to be Used (If Applicable) <input type="checkbox"/> Paint Color Chart (If Applicable) <input type="checkbox"/> Detailed Bolted Splices (If Applicable) <input type="checkbox"/> Bolted Splice Location (If applicable) <input type="checkbox"/> Signature and Seal of Professional Engineer, licensed in Accordance with Section 3.0 | <ul style="list-style-type: none"> <input type="checkbox"/> Weld Failure Checks (Ultimate) <input type="checkbox"/> Local Buckling of the Main Member <input type="checkbox"/> Main Member Yielding Failure Checks <input type="checkbox"/> Main Member Crippling Failure Checks <input type="checkbox"/> Main Member Buckling Failure Checks <input type="checkbox"/> Main Member Shear Failure Checks <input type="checkbox"/> All Bolted Splice Checks (if applicable) <input type="checkbox"/> Main Truss Deflection Checks <input type="checkbox"/> Decking Material Checks <input type="checkbox"/> "U-Frame" Stiffness Checks (if applicable) <input type="checkbox"/> Interior and End Portal Design Checks (if applicable) <input type="checkbox"/> Determination of Top Chord K Factor Based on "U-
Stiffness (if applicable) <input type="checkbox"/> Consideration of Individual Member Moments Due to
Truss Deflection, Joint Fixity and Joint |
|--|--|

DESIGN CALCULATIONS

Data Required to be Shown:

- Data Input for 3-D Analysis of Bridge
 - Joint Coordinates & Member Incidences
 - Joint and Member Loads
 - Member Properties
 - Load Combinations
- AASHTO Member Stress Checks for Each Member Type
- Critical Connection Failure Mode Checks For Each Member Type
 - Chord Face Plastification Checks
 - Punching Shear Checks

FABRICATION SUBMITTALS

Data Required to be Shown:

- ** Written Installation Instructions
- ** Written Splicing Instructions
- ** Written Maintenance & Inspection Instructions
- ** Welder Certifications
- ** Welding Procedures
- Material Certifications (if applicable)
 - Structural Steel (if applicable)
 - Decking (if applicable)
 - Structural Bolts (if applicable)
 - ** Quality Control Section of AISC Certification Manual (if applicable)
 - ** Painter Certifications (if applicable)
 - Weld Testing Reports (if applicable)

**** NOTE:** These items are required to be

along with Submittal Drawings and Design

SECTION 640184 - SPECIAL SPECIFICATIONS FOR PREFABRICATED BRIDGE

Calculations.


- Material Failure Checks (Truss Webs)
- Weld Failure Checks (Effective Length)

Those Fabrication Submittal Items not marked are to be submitted prior to shipment of the bridge.

Appendix A

1/K FOR VARIOUS VALUES OF CL/P_c and n

1/K	n						
	4	6	8	10	12	14	16
1.000	3.686	3.616	3.660	3.714	3.754	3.785	3.809
0.980		3.284	2.944	2.806	2.787	2.771	2.774
0.960		3.000	2.665	2.542	2.456	2.454	2.479
0.950			2.595				
0.940		2.754		2.303	2.252	2.254	2.282
0.920		2.643		2.146	2.094	2.101	2.121
0.900	3.352	2.593	2.263	2.045	1.951	1.968	1.981
0.850		2.460	2.013	1.794	1.709	1.681	1.694
0.800	2.961	2.313	1.889	1.629	1.480	1.456	1.465
0.750		2.147	1.750	1.501	1.344	1.273	1.262
0.700	2.448	1.955	1.595	1.359	1.200	1.111	1.088
0.650		1.739	1.442	1.236	1.087	0.988	0.940
0.600	2.035	1.639	1.338	1.133	0.985	0.878	0.808
0.550		1.517	1.211	1.007	0.860	0.768	0.708
0.500	1.750	1.362	1.047	0.847	0.750	0.668	0.600
0.450		1.158	0.829	0.714	0.624	0.537	0.500
0.400	1.232	0.886	0.627	0.555	0.454	0.428	0.383

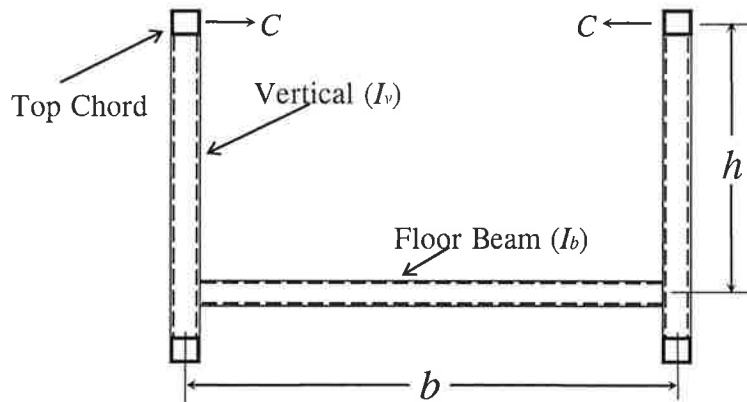

Where: $C = \frac{E \text{ "U - Frame"}}{h^2 [h/3I_v + b/2I_b]}$

L = Length in inches of one truss panel

P_c = Buckling Load (= Top Chord Compression x F.S.)

n = Number of Panels

Reference: Galambos, T.V. (1988) "Guide to Stability Design Criteria for Metal Structures", 4th Ed., PP 515-529. Copyright © 1988. Reprinted by permission of John Wiley and Sons, Inc.